

BICARB BULLETIN



Desulfurization of Power Station Flue Gases with Sodium Bicarbonate

SO₂ Removal with Dry Sodium Bicarbonate Injection at the City of Gardanne (Bouches du Rhône – France) Coal-Fired Power Station

The effectiveness of sodium bicarbonate for removing SO₂ from power station flue gases has already been proved for certain types of fuel:

- Fuel oil with a 1% sulfur content, in trials carried out at the SOLVAY factory at Heilbronn (West Germany).
- Coal at 1.4% sulfur content, during trials at the OMNICAL plant at Ewersbach (West Germany).

The tests carried out at the city of Gardanne power station have enabled the purification of flue gases given off by the combustion of high sulfur coal to be studied.

These tests were carried out from February 27 to March 3, 1989, by the SOLVAY Study and Research Centre at Dombasle (France), which also provided the mobile unit used for pulverizing and injecting the sodium bicarbonate into the gases to be purified, as well as measuring the SO₂ content of the flue gases.

Description of the Installation

The City of Gardanne power station is fitted with two boilers with the following characteristics:

- Thermal power (per unit): 2.5 MW
- Type: VATC
- Model: grid hearth with recirculation of primary air
- Manufacturer: Seccatier
- Fuel: Provence lignite – locally mined bright burning coal with high sulfur content (>5%)

This power station is also fitted with a smoke processing unit supplied by Syprim – Air Industrie Environment.

The bicarbonate is first pulverized in the Dombasle Research Centre's mobile installation (Alpine 315 UPZ pulverizer). It is then injected into a venturi, counter-current to the combustion gases coming from the boilers.

Desulfurization of Power Station Flue Gases with Sodium Bicarbonate

At this location the turbulence assures thorough mixing of the bicarbonate into the gases.


The reaction between the bicarbonate and the sulfur dioxide takes place in a reactor consisting of two concentric tubes. The residence time of the gases between the bicarbonate injection point and the reactor is around 1.5 seconds. The gases are then filtered in a bag filter, which retains the purification reaction products.

For a given batch of coal, the level of SO₂ in the flue gas varies only slightly. For this reason it was simple to regulate optimally the amounts of sodium bicarbonate required. In order to study the influence of the stoichiometric ratio on the effectiveness of the purification, the feed rate of the bicarbonate was varied between 40 and 120 kg/h.

The SO₂ content was measured by bubbling part of the flue gases through H₂O₂ solutions. The analyses were carried out on a DIONEX QIC anion chromatograph.

Stoichiometric Ratio

In order to remove SO₂, the following global reaction applies:



(2 moles NaHCO₃ for 1 mole SO₂ correspond to a stoichiometric ratio of 1)

In other words,

2 x 84/64 = 2.625 kg of NaHCO₃ are required in order to remove 1 kg of SO₂.


Testing

The following average values were measured at the bicarbonate injection point:

- Flue gas temperatures: 214°C
- SO₂ content: 9200 mg/Nm³ ± 3%

A range of stoichiometric ratios between 0.5 and 1.6 was covered.

Diagram no. 1

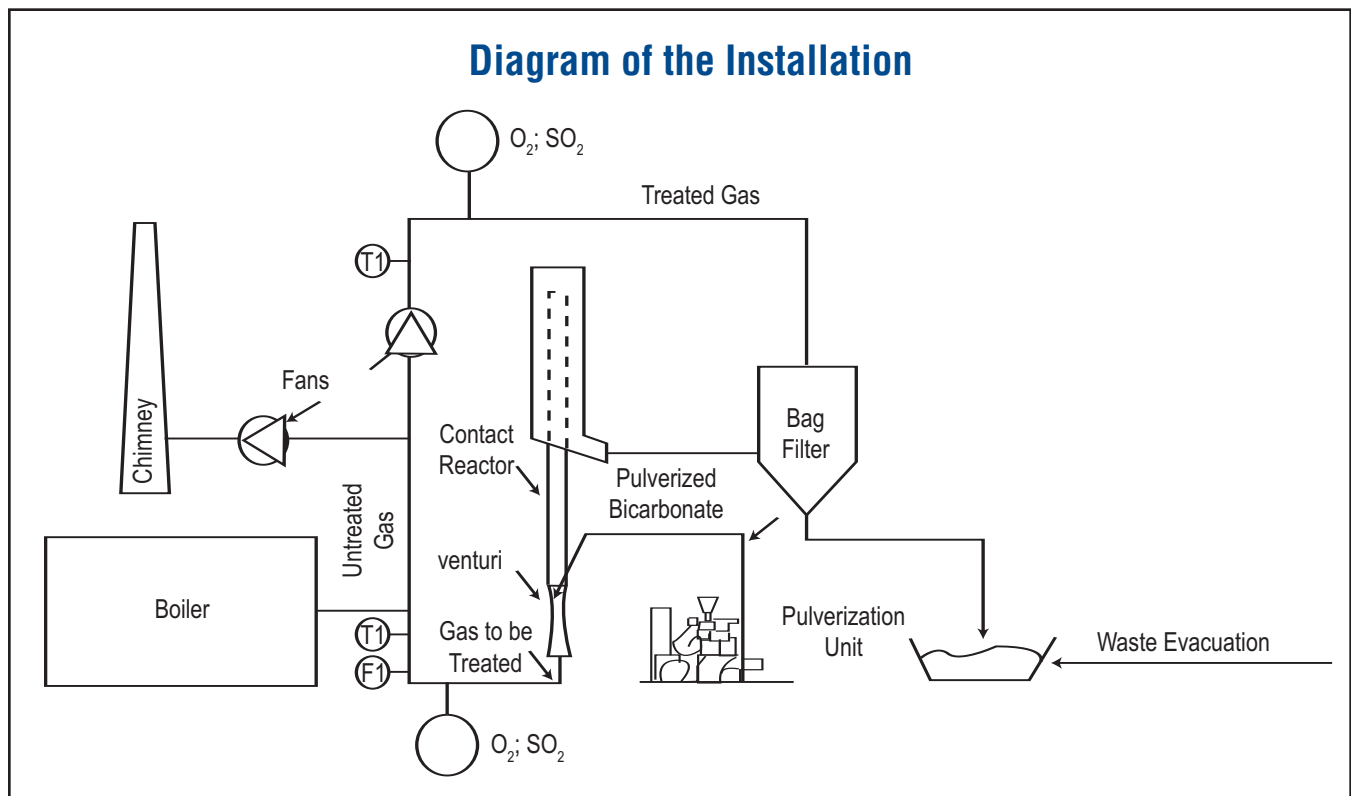

Desulfurization of Power Station Flue Gases with Sodium Bicarbonate

Test Results

Table 1: Effectiveness of SO₂ removal

Pollutant	% Removal	Stoichiometric Ratio	
		Average	Maximum
SO ₂	80	0.9	1.05
	90	1.05	1.2

These results demonstrate the excellent effectiveness of sodium bicarbonate for desulfurizing flue gases. The low level of variation in the SO₂ content enabled almost the maximum possible effectiveness to be obtained.

Table 2: SO₂ content of the purified gases


Pollutant	Content mg/Nm ³ dry gas at 7% O ₂	Stoichiometric Ratio	
		Average	Maximum
SO ₂	1000	1.05	1.2
	500	1.35	1.6

The SO₂ content was reported at a 7% oxygen dilution, which corresponds to the normal operating level of a grid hearth boiler.


In calculating maximum values, an uncertainty margin of 15% has been added to average values, corresponding to the degree of error inherent in the measurement.

The SO₂ content of the purified gases may appear high, but this must be seen in relation to the very high SO₂ content of the untreated flue gas.

Graph 1: % SO₂ removed in relation to stoichiometric ratio

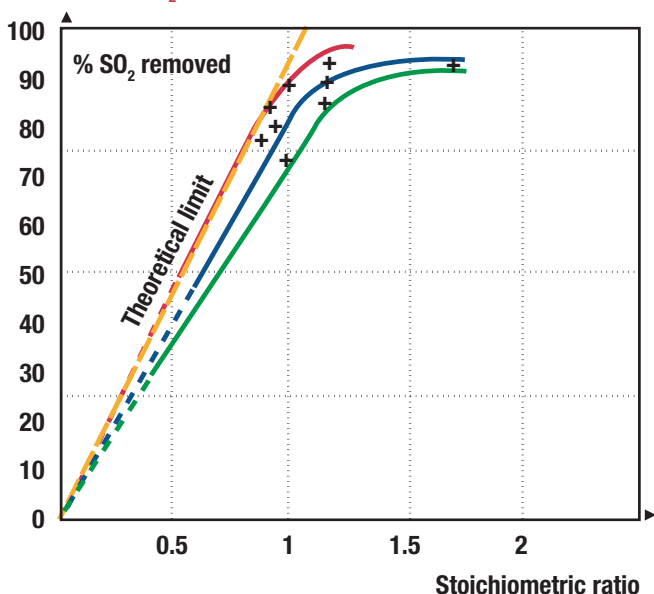

Graph 2: SO₂ content of purified flue gases as a function of the stoichiometric ratio

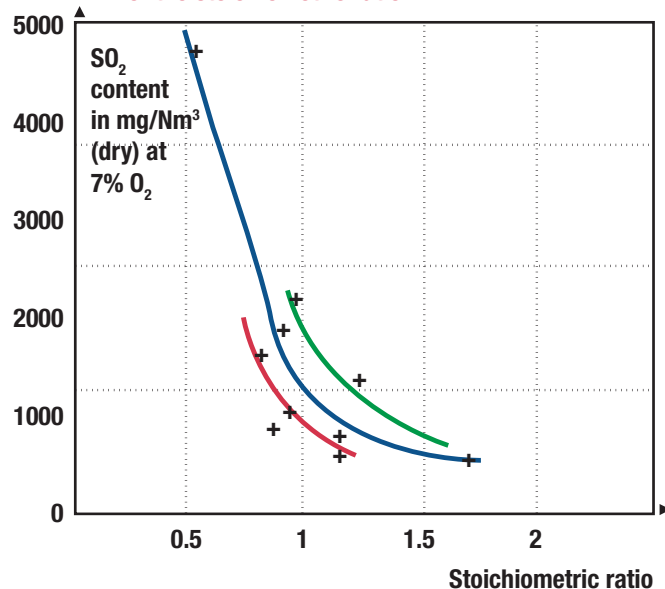

Conclusion

These results confirm the very high level of effectiveness of sodium bicarbonate for desulfurizing flue gases arising from the combustion of high sulfur coal.

90% of the SO₂ present in the gases was removed with a stoichiometric ratio between 1.05 and 1.2.

The low degree of variation in pollutant levels permitted optimal regulation of the amount of sodium bicarbonate required.